


EX-1000, 12V 100AH

OCV. :	12.55	BACK UP @ 400 WATTS
Sp.Gr.:	1.240	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
00:00	12.55	32.93	1.235	26
00:15	12.01	32.88	1.243	26
00:30	11.98	32.8	1.241	26
00:45	11.72	31.94	1.238	27
01:00	11.26	31.87	1.230	27
01:15	11.01	31.76	1.226	27
01:30	10.64	31.5	1.220	28
01:45	10.5	-	1.217	28

EX-1000, 12V 100AH

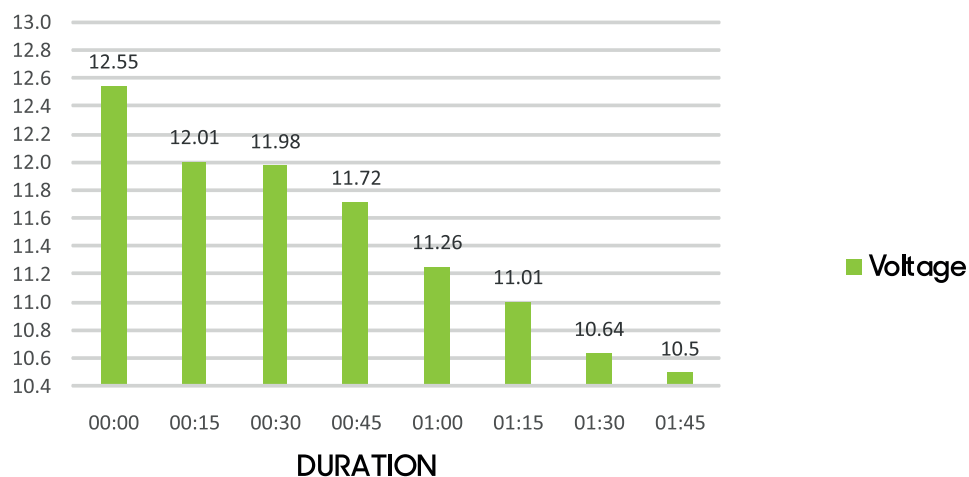

* Note : Above Backup comes after 4th Cycle.




EX-1500, 12V 150AH

OCV. :	12.61	BACK UP @ 400 WATTS
Sp.Gr.:	1.255	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
00:00	12.61	33.50	1.255	26
00:15	12.01	33.44	1.253	26
00:30	11.9	33.19	1.248	27
00:45	11.77	32.46	1.242	27
01:00	11.51	32.31	1.239	27
01:15	11.43	32.79	1.234	27
01:30	11.36	32.15	1.226	28
01:45	11.24	32.06	1.225	28
02:00	11.13	32.00	1.220	29
02:15	10.96	31.8	1.215	29
02:30	10.71	30.33	1.212	30
02:50	10.50	-	1.200	30

EX-1500, 12V 150AH

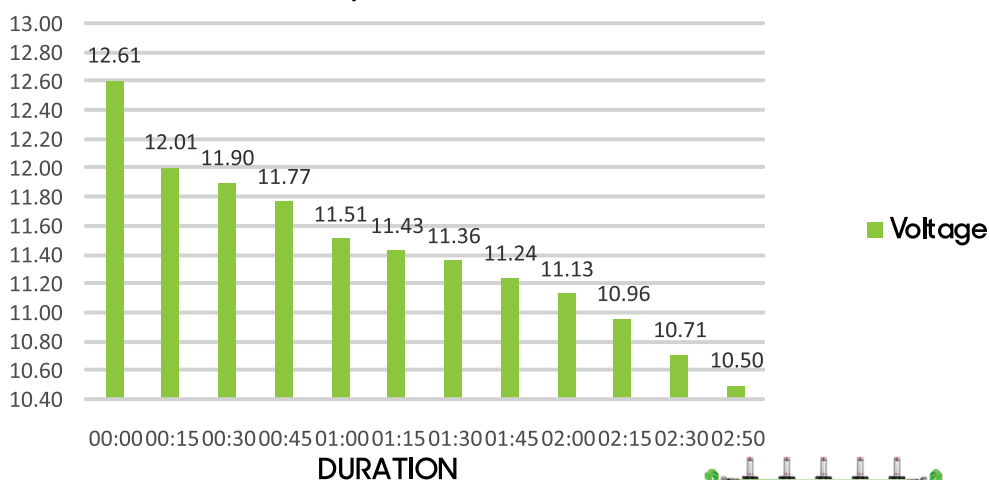

* Note : Above Backup comes after 4th Cycle.




EX-1800, 12V 180AH

OCV. :	12.61	BACK UP @ 400 WATTS
Sp.Gr.:	1.257	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
0:00	12.61	32.87	1.257	26
0:30	12.03	32.00	1.245	26
1:00	11.85	31.52	1.239	27
1:30	11.65	31.81	1.231	27
2:00	11.52	31.2	1.223	27
2:30	11.25	31.00	1.212	27
3:00	11.00	30.89	1.202	28
3:30	10.75	30.06	1.200	28
3:45	10.50	-	1.200	29

EX-1800, 12V 180AH

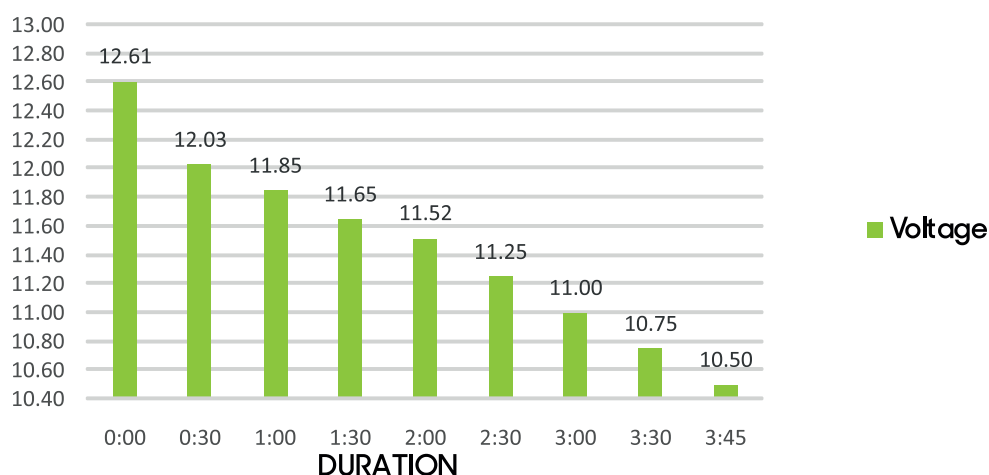

* Note : Above Backup comes after 4th Cycle.




EX-2000, 12V 200AH

OCV. :	12.59	BACK UP @ 400 WATTS
Sp.Gr.:	1.256	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
0:00	12.61	32.87	1.257	26
0:30	12.25	32.55	1.252	26
1:00	12.03	32.00	1.245	26
1:30	11.85	31.52	1.239	27
2:00	11.65	31.81	1.231	27
2:30	11.52	31.2	1.223	27
3:00	11.25	31.00	1.212	27
3:30	11.00	30.89	1.202	28
4:00	10.75	30.06	1.200	28
04:15	10.50	-	1.200	29

EX-2000, 12V 200AH

■ Voltage

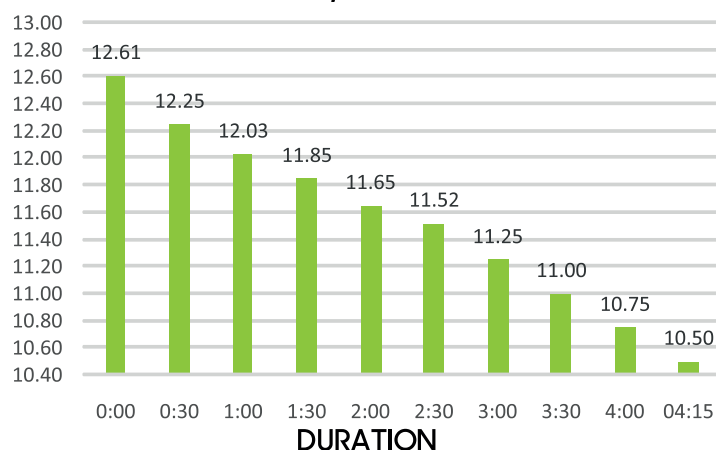

* Note : Above Backup comes after 4th Cycle.




EX-2200, 12V 220AH

OCV. :	12.63	BACK UP @ 400 WATTS
Sp.Gr.:	1.257	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
0:00	12.61	32.87	1.257	26
0:30	12.25	32.55	1.252	26
1:00	12.03	32.00	1.245	26
1:30	11.85	31.52	1.239	27
2:00	11.65	31.81	1.231	27
2:30	11.52	31.20	1.223	27
3:00	11.40	31.20	1.223	27
3:30	11.25	31.00	1.212	27
4:00	11.00	30.89	1.202	28
04:30	10.75	30.06	1.200	28
04:40	10.50	-	1.200	29

EX-2200, 12V 220AH

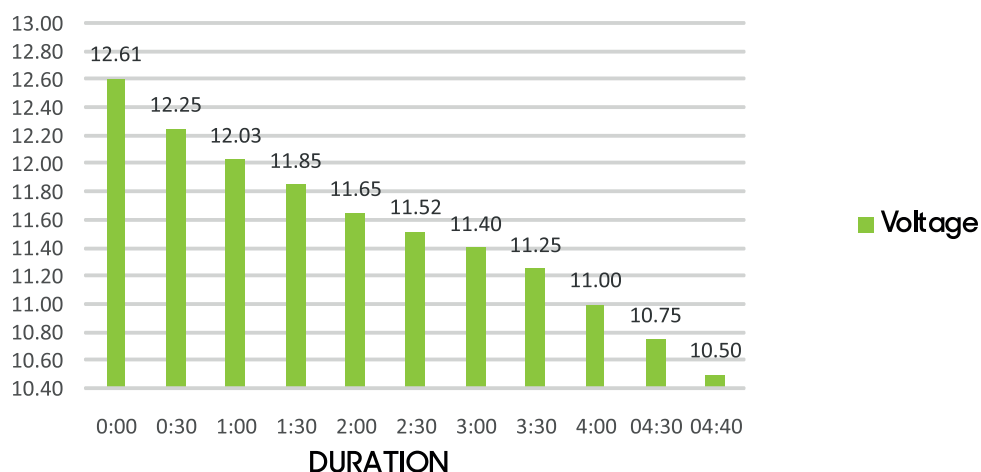

* Note : Above Backup comes after 4th Cycle.




EX-2400, 12V 240AH

OCV. :	12.63	BACK UP @ 400 WATTS
Sp.Gr.:	1.257	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
0:00	12.61	32.87	1.257	26
0:30	12.25	32.55	1.252	26
1:00	12.03	32.00	1.245	26
1:30	11.85	31.52	1.239	27
2:00	11.65	31.81	1.231	27
2:30	11.52	31.20	1.223	27
3:00	11.40	31.20	1.223	27
3:30	11.25	31.00	1.212	27
4:00	11.00	30.89	1.202	28
04:30	10.75	30.06	1.200	28
05:00	10.50	-	1.200	29

EX-2400, 12V 240AH

■ Voltage

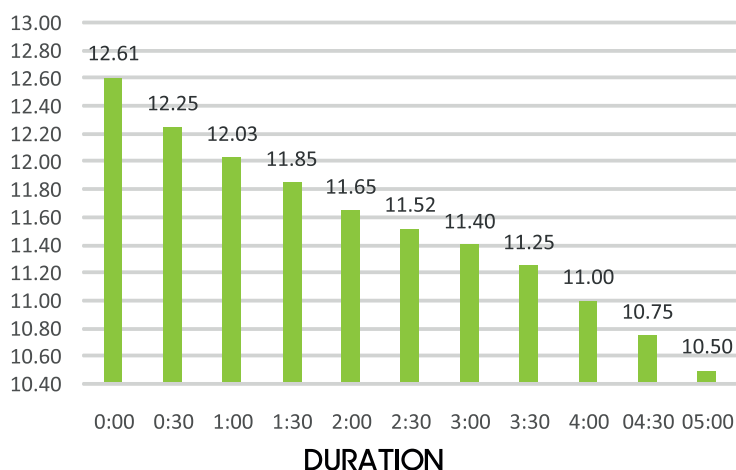

* Note : Above Backup comes after 4th Cycle.




EX-2600, 12V 260AH

OCV. :	12.69	BACK UP @ 400 WATTS
Sp.Gr.:	1.265	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
0:00	12.61	32.87	1.257	26
0:30	12.25	32.55	1.252	26
1:00	12.03	32.00	1.245	26
1:30	11.90	32.15	1.242	27
2:00	11.85	31.52	1.239	27
2:30	11.65	31.81	1.231	27
3:00	11.52	31.20	1.223	27
3:30	11.40	31.20	1.223	27
4:00	11.25	31.00	1.212	27
04:30	11.00	30.89	1.202	28
05:00	10.75	30.06	1.200	28
05:30	10.50	-	1.200	29

EX-2600, 12V 260AH

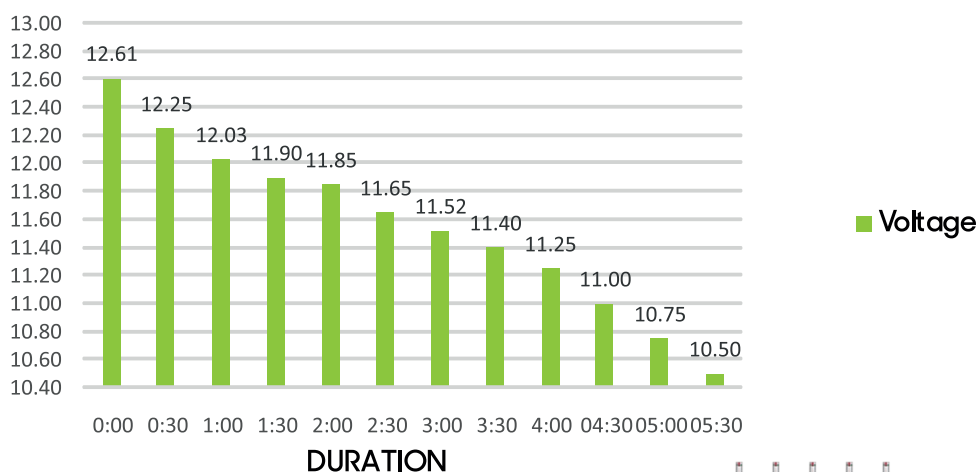

* Note : Above Backup comes after 4th Cycle.




EX-3000, 12V 300AH

OCV. :	12.69	BACK UP @ 400 WATTS
Sp.Gr.:	1.265	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
00:00	12.7	33	1.265	26
00:30	12.61	32.9	1.257	26
01:00	12.25	32.87	1.245	26
01:30	12.03	32	1.242	27
02:00	11.9	32.15	1.239	27
02:30	11.85	31.52	1.231	27
03:00	11.65	31.81	1.223	27
03:30	11.52	31.2	1.22	27
04:00	11.4	31.2	1.212	27
04:30	11.25	31	1.202	28
05:00	11	30.89	1.2	28
05:30	10.75	30.06	1.195	29
06:00	10.6	30.05	1.19	29
06:30	10.5	30	1.185	29

EX-300, 12V 300AH

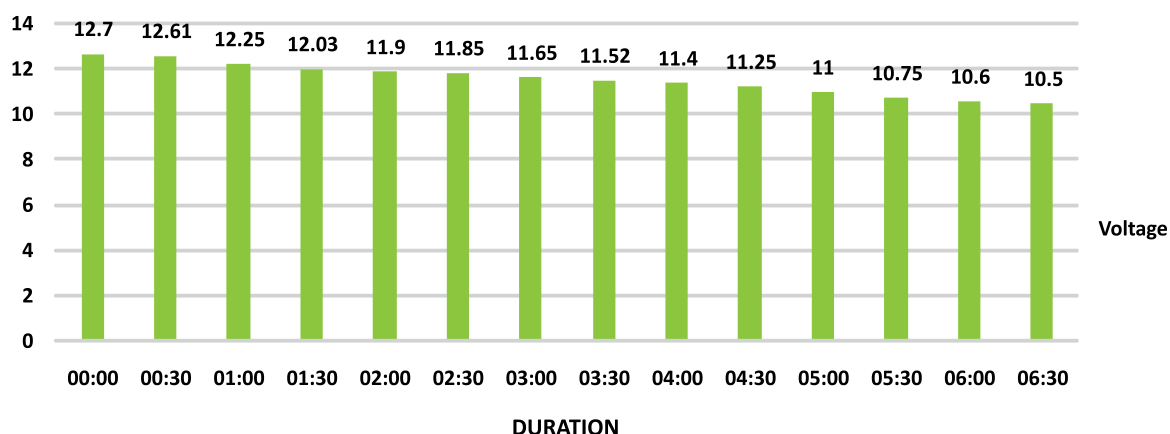

* Note : Above Backup comes after 4th Cycle.




EX-3300, 12V 330AH

OCV. :	12.69	BACK UP @ 400 WATTS
Sp.Gr.:	1.265	
Temp.:	26°C	

Duration	Voltage	Current	Sp. Gr.	Temperature in °C
00:00	12.8	33	1.275	26
00:30	12.75	33	1.27	26
01:00	12.7	33	1.265	26
01:30	12.61	32.9	1.257	26
02:00	12.25	32.87	1.245	26
02:30	12.03	32	1.242	27
03:00	11.9	32.15	1.239	27
03:30	11.85	31.52	1.231	27
04:00	11.65	31.81	1.223	27
04:30	11.52	31.2	1.22	27
05:00	11.4	31.2	1.212	27
05:30	11.25	31	1.202	28
06:00	11	30.89	1.2	28
06:30	10.75	30.06	1.195	29
07:00	10.6	30.05	1.19	29
07:30	10.5	30	1.185	29

EX-330, 12V 330AH

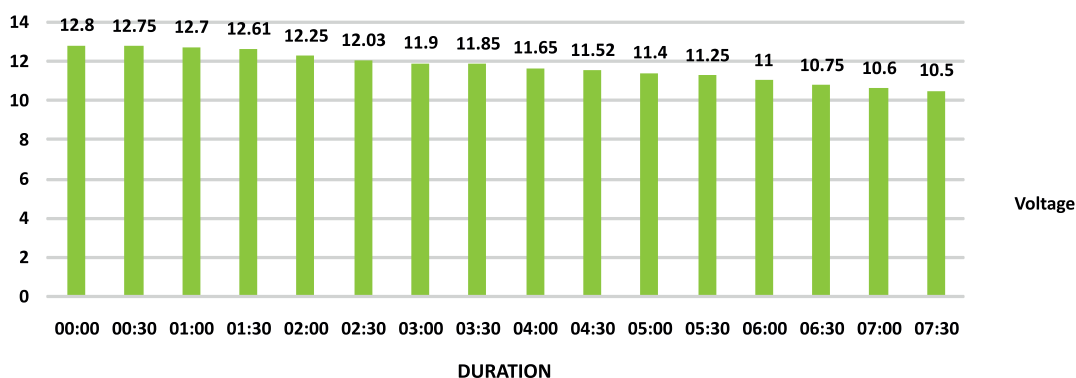

* Note : Above Backup comes after 4th Cycle.

